

Certificate No: CBA-E21-C-B2


Issued : January 2016

Issued by Concrete Block Association

| | | |
|---|---------------|--|
| Exposed Floor (inverted) Table K.1 Ref E21 Approved ψ -value = 0.32 W/mK | Inner leaf | 100 mm blockwork |
| | Cavity | Partial cavity fill with low-e facing and 50mm cavity |
| | Outer leaf | 102 mm brick $\lambda = 0.77$ |
| | Exposed floor | Precast hollow core concrete floor with vehicle access below and 150mm of insulation, $\lambda = 0.037$ below the hollow core deck |

Key Points

1. Ensure that the floor insulation is tightly butted to the wall
2. Install perimeter insulation with a resistance of at least 0.8 m²K/W at the edges of the screed

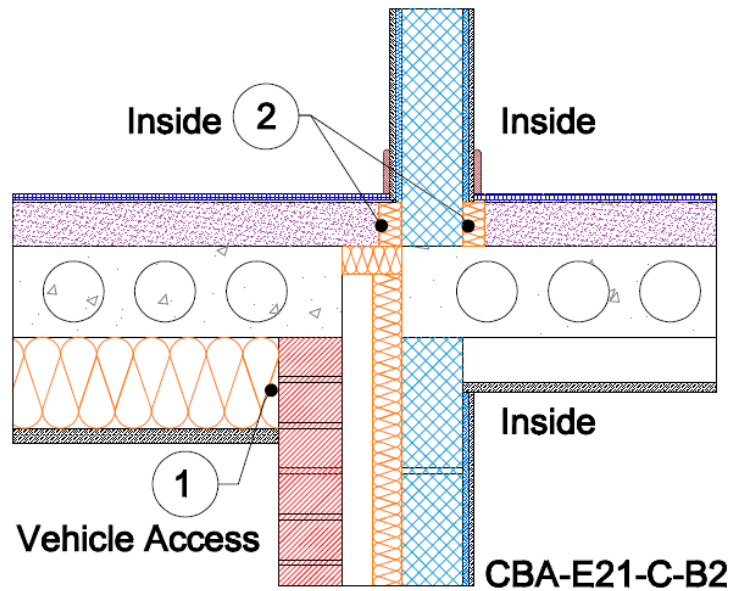

Calculations have been performed in accordance with:
BS EN ISO 10211:2007, BR497 and BS EN ISO 13370:2007

Calculation prepared by : Chris Sanders B.Sc, M.Sc. GCU, Cowcaddens Rd, Glasgow G4 0BA
For more information contact 0116 232 5165 (CBA).

Calculated ψ -values and f-values for exposed floor (inverted) and **cavity insulation** as highlighted

| Cavity Insulation | Inner leaf blockwork | | | | | |
|-----------------------|-----------------------|---------|-----------------------|---------|-----------------------|---------|
| | Ultra lightweight | | Lightweight | | Dense | |
| | ψ -value W/mK | f-value | ψ -value W/mK | f-value | ψ -value W/mK | f-value |
| 50mm $\lambda=0.022$ | 0.172 | 0.920 | 0.170 | 0.920 | 0.170 | 0.920 |
| 100mm $\lambda=0.022$ | 0.171 | 0.920 | 0.170 | 0.920 | 0.171 | 0.920 |

The f-value should be above 0.75 to minimise the risk of mould in dwellings.

On-site Checklist

1. Floor insulation is tightly butted to the wall
2. Perimeter insulation with a resistance of at least 0.8 m²K/W installed at the edges of the screed

Signed:

Site manager/supervisor.....

Site name.....

Plot Number.....

Date.....